


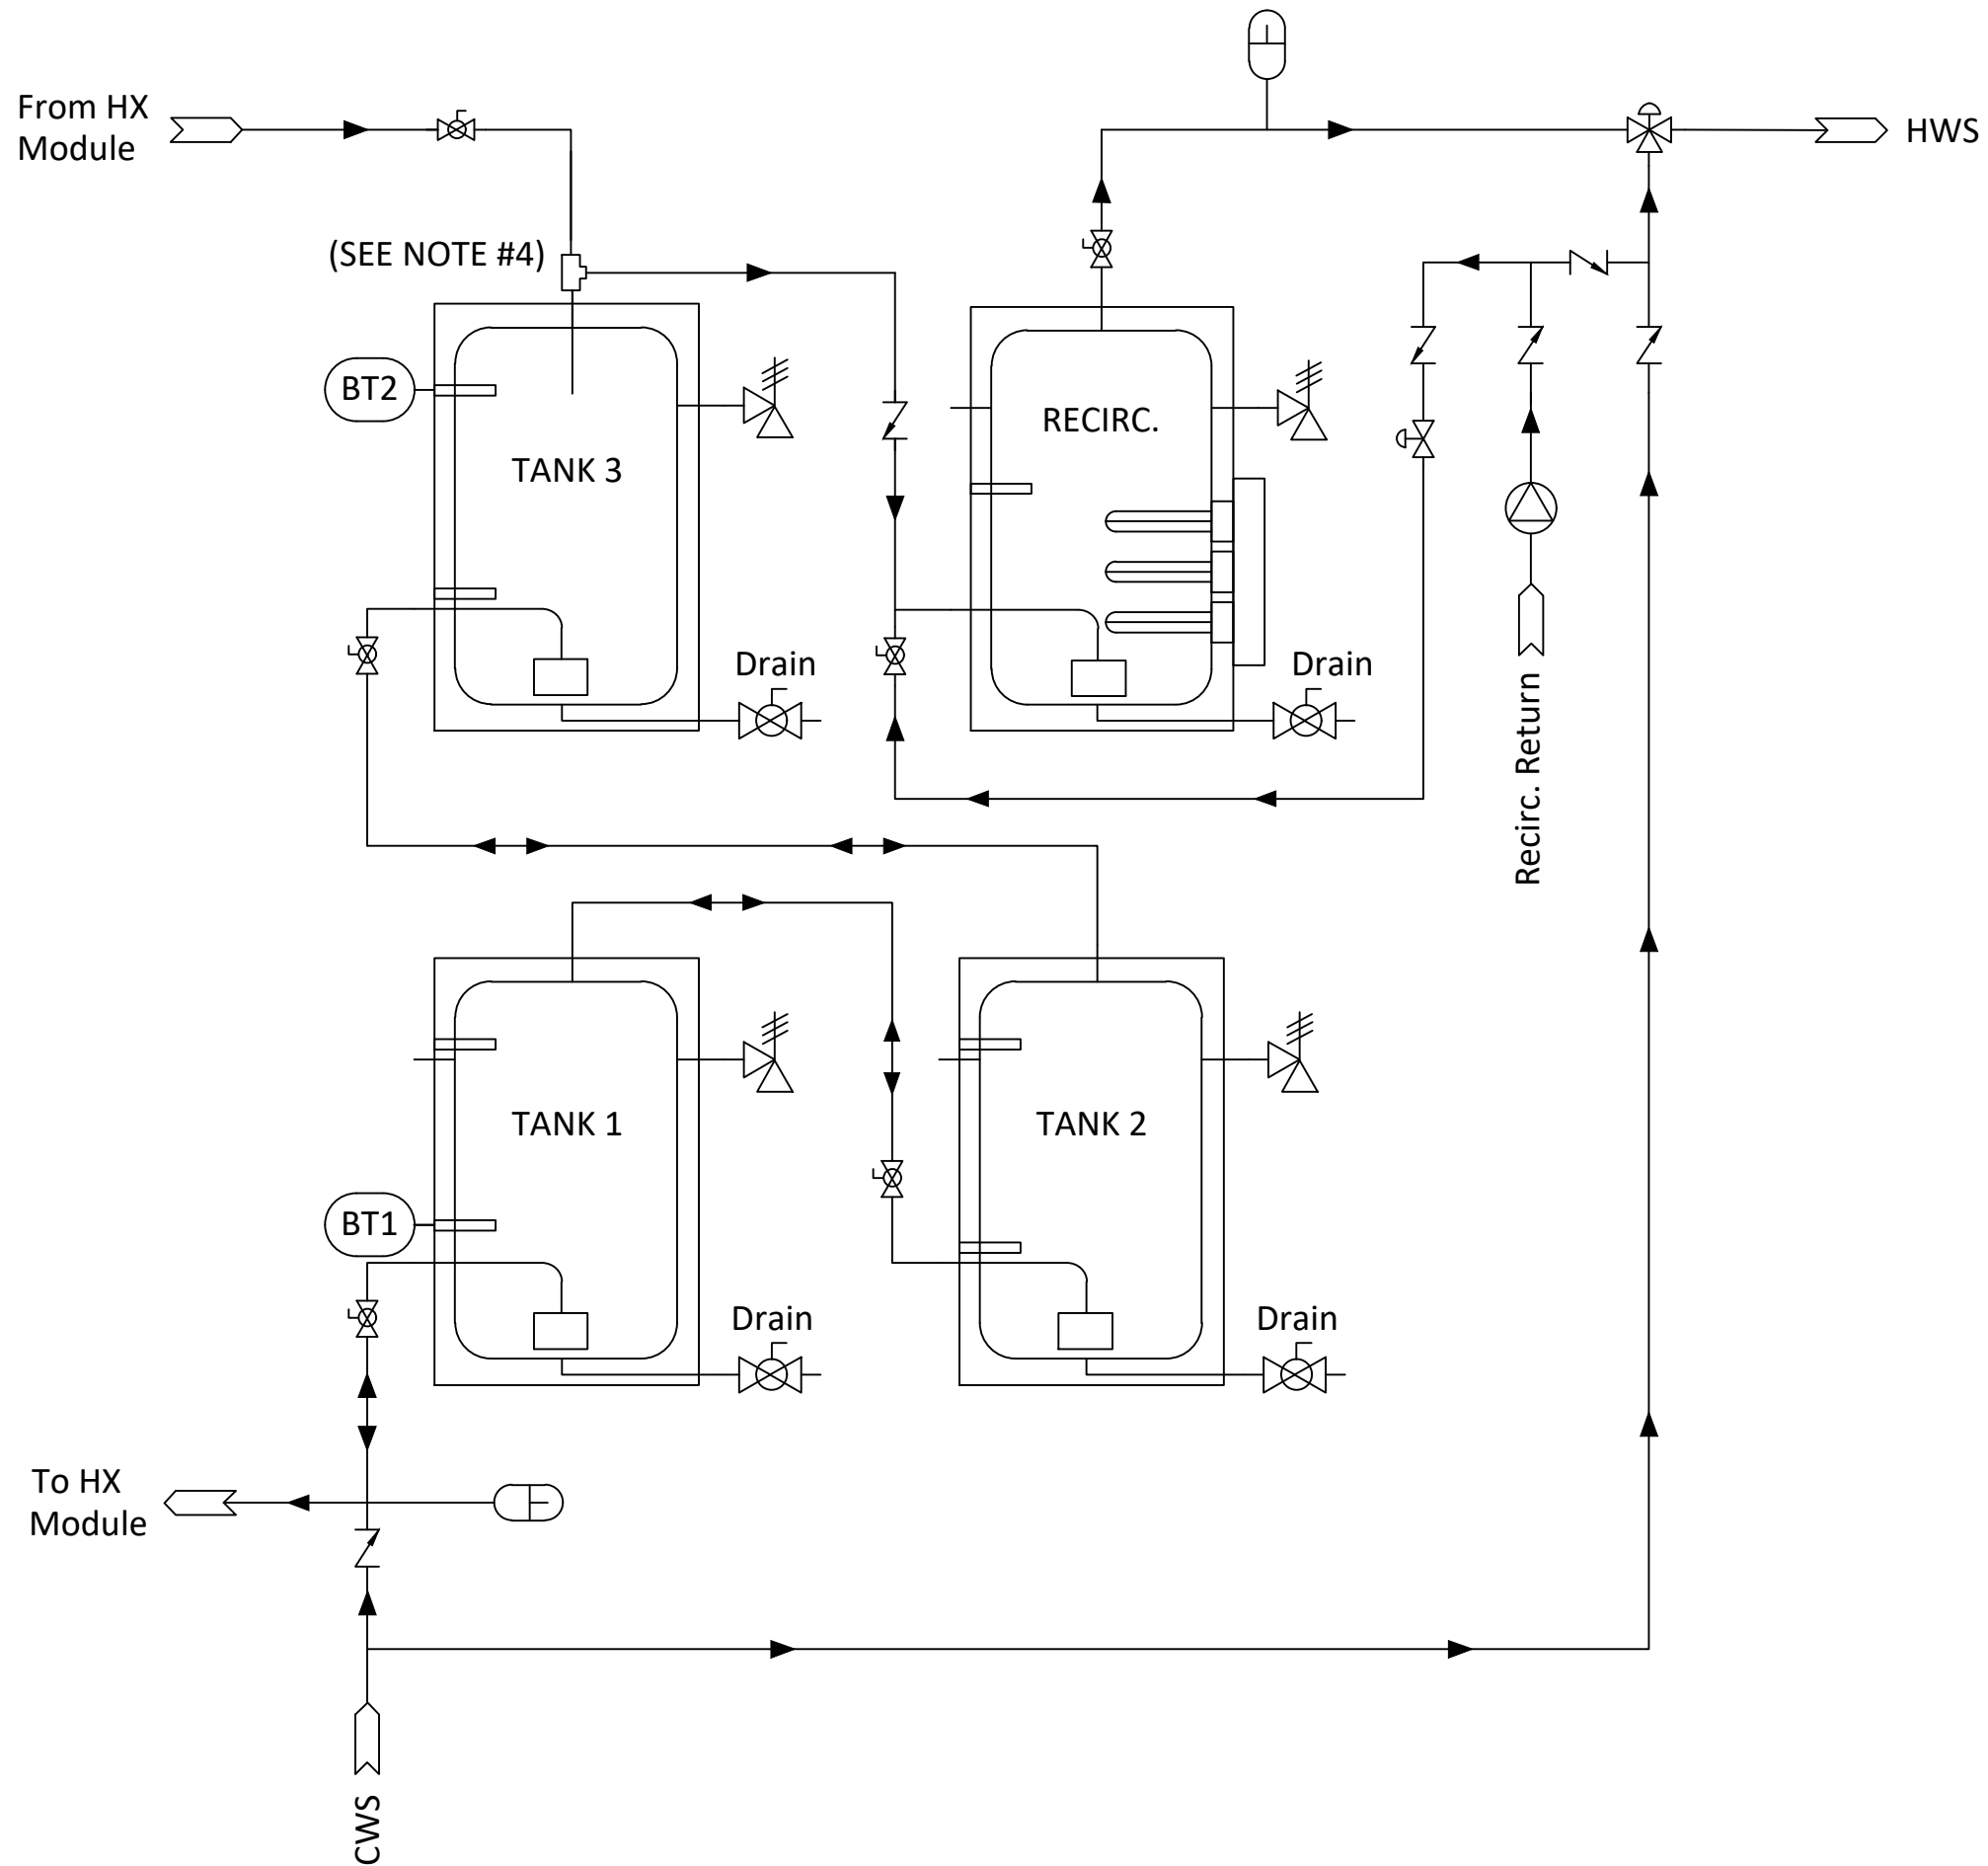

Symbols

	Pressure Relief Valve
	Balance Valve
	Pump
	Mixing Valve
	Ball Valve
	Check Valve
	Expansion Vessel
	Diffuser Tee

NOTES:

- 1) NOT FOR CONSTRUCTION.
- 2) RECIRCULATION LOOP BY OTHERS.
- 3) COLD WATER EXPANSION TANK MUST BE LOCATED AFTER CHECK VALVE.
- 4) LOCATE DIFFUSER TEE IN LAST STORAGE TANK.



Blauvelt, NY
Fort Worth, TX

AEGIS 3 TANKS + RECIRC.
INSTALLATION

DWN.BY K.S. DATE 090622
SCALE NTS
REV.BY K.S. DATE 080225

SD-L-1263

REV.
D