



PLC INSIDE AEGIS

Run Additional Set of Wires For Future Expansion

TO SEQUENCER WHEN MULTIPLE HEAT PUMPS ARE USED

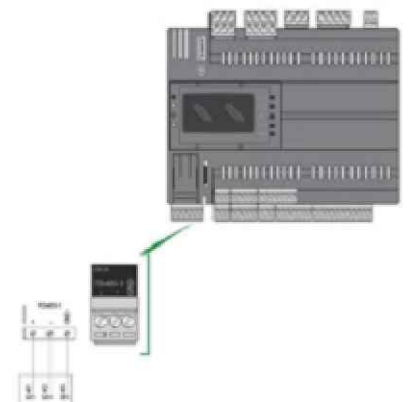

Use RS485 port for:  
- MODBUS RTU  
- BACnet MSTP

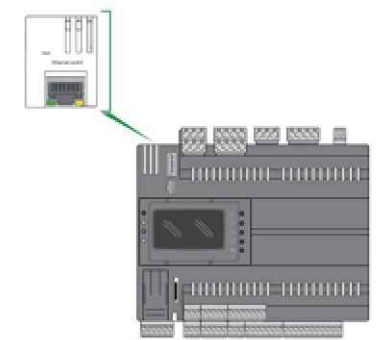

Use the Ethernet port on the top of the controller for:  
- MODBUS TCP  
- BACnet IP

A cable is supplied with the unit to the external connection.

- NOTES:
- 1) NOT FOR CONSTRUCTION.
  - 2) CWR OPTION ONLY, SOURCE SELECTION PRIMARY:  
AIR-SOURCE = OPEN , WATER-SOURCE = CLOSED
  - 3) \* SENSORS REQUIRED FOR SINGLE HEAT PUMP APPLICATIONS

- CAT5e / CAT6 as per BMS (BACnet IP)
- - - 18 AWG Twisted and Shielded Wire (150' max), 16 AWG (150' - 270') or 15 AWG 270' to 360')
- ..... 24 AWG min

		Blauvelt, NY Fort Worth, TX
AEGIS MII LOW VOLTAGE		
DWN.BY <u>K.S.</u> DATE <u>030524</u> SCALE <u>NTS</u> REV.BY <u>K.S.</u> DATE <u>030725</u>	SD-L-1286	REV. B