


TO SEQUENCER  
WHEN MULTIPLE  
HEAT PUMPS ARE  
USED

Use RS485 port for:  
- MODBUS RTU  
- BACNet MSTP

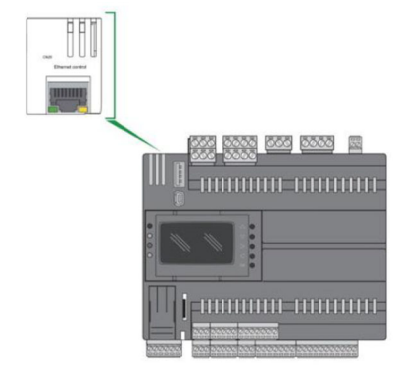

Use the Ethernet port on the top of the controller for:  
- MODBUS TCP  
- BACNet IP

A cable is supplied with the unit to the external connection.

- NOTES:  
 1) NOT FOR CONSTRUCTION.  
 2) CWR OPTION ONLY, SOURCE SELECTION PRIMARY:  
 AIR-SOURCE = OPEN , WATER-SOURCE = CLOSED  
 3) \* SENSORS REQUIRED FOR SINGLE HEAT PUMP APPLICATIONS

		Blauvelt, NY Fort Worth, TX
AEGIS MII LOW VOLTAGE		
DWN.BY <u>K.S.</u> DATE <u>030524</u> SCALE <u>NTS</u> REV.BY <u>K.S.</u> DATE <u>030725</u>	SD-L-1286	REV. B